

The Controlled Active Ventilation Environment Laboratory (CAVE) – Resilient Buildings and Indoor Environments

Dr Liora Malki-Epshtein, Director, CAVE

Department of Civil, Environmental and Geomatic Engineering (CEGE), UCL

TAPAS

Tackling air pollution at school



The built environment we live in - challenges

- Some of the biggest challenges facing the world today are population growth, rapid urbanisation, and climate change.
- These trends result in urban overcrowding, traffic, air pollution, increased transmission of infectious diseases, and high energy consumption and carbon emissions.
- Building design guidelines are appropriate and many improvements are possible.
- But -> the actual quality of ventilation across the UK building stock is unknown
- This makes it impossible to assess the overall indoor air quality of schools, hospitals, offices, restaurants, performance venues, museums and galleries, buses and trains around the UK
- Our ignorance of the scale of the problem means we cannot estimate the health impacts of “ordinary” poor indoor air quality and disease transmission

Context: COVID-19, Airborne transmission is established

- Super-spreading events were seen as evidence of airborne transmission of SARS-CoV-2, especially in very poorly ventilated spaces

Risk factors for airborne transmission include:

- Duration of time spent in a space
- Activities that may generate more viral aerosols (singing, loud talking, aerobic exercise)
- Low ventilation rates
- Large number of people present

[Environ Int.](#) 2020 Jun; 139: 105730.

Published online 2020 Apr 10. doi: [10.1016/j.envint.2020.105730](https://doi.org/10.1016/j.envint.2020.105730)

PMCID: PMC7151430

PMID: [32294574](https://pubmed.ncbi.nlm.nih.gov/32294574/)

Airborne transmission of SARS-CoV-2: The world should face the reality

[Lidia Morawska](#)^{a,*} and [Junji Cao](#)^b

► [Author information](#) ► [Article notes](#) ► [Copyright and License information](#)

This article has been [cited by](#) other articles in PMC.

Abstract

 Centers for Disease Control and Prevention
CDC 24/7: Saving Lives, Protecting People™

Search

Morbidity and Mortality Weekly Report (MMWR)

CDC

High SARS-CoV-2 Attack Rate Following Exposure at a Choir Practice – Skagit County, Washington, March 2020

Weekly / May 15, 2020 / 69(19);606–610

On May 12, 2020, this report was posted online as an MMWR Early Release.

Lidia Morawska



Anthony Weiss/CUT

nature

[Explore content](#) ▼ [About the journal](#) ▼ [Publish with us](#) ▼ [Subscribe](#)

[nature](#) > [news feature](#) > [article](#)

NEWS FEATURE | 06 April 2022

Why the WHO took two years to say COVID is airborne

Early in the pandemic, the World Health Organization stated that SARS-CoV-2 was not transmitted through the air. That mistake and the prolonged process of correcting it sowed confusion and raises questions about what will happen in the next pandemic.

Research on COVID-19 transmission – IAQ/Ventilation monitoring buses

COVID response research questions:


- How to protect bus drivers from prolonged exposure to COVID-19
- How long do episodes of poor air quality last?
- What time of day is worst?
- How many people are on board when air quality deteriorates?
- How many windows need to be kept open?
- Can the impact of national restrictions be understood from IAQ on buses?

Current Research:

- What should ventilation targets be?
- What are the measured temperatures on buses throughout the year
- What is the energy cost?

Project team:

Liora Malki-Epshtein
Filipa Adzic
Oliver Wild
Nick Tyler
Lena Ciric (VIRAL PI)
Thorsten Stoesser,
Alex Stubbs, Arthur
Hajaali
Taku Fujiyama

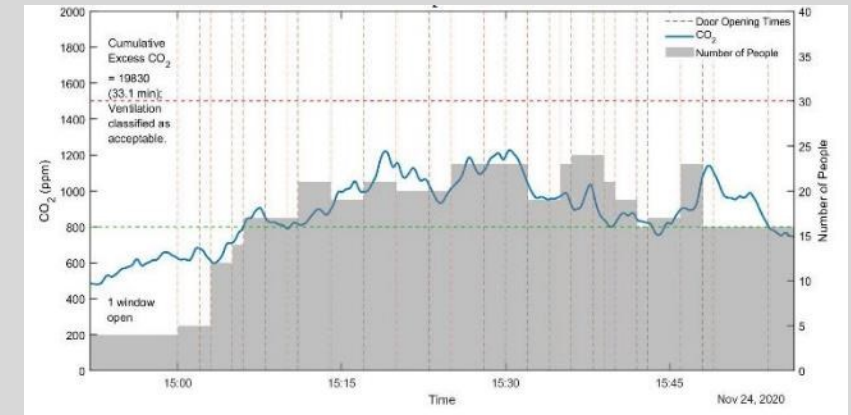

CO₂, Door Opening Times and Number of Passengers



Project VIRAL: bit.ly/uclviral


The Events Research Programme: Large scale Monitoring of IAQ

The AIRBODS project – to deliver guidance on the ventilation operation and future design of non-domestic buildings and to quantify the risk of, and reduce the transmission of SARS-CoV-2 in buildings, led by Prof Malcolm Cook, was funded by the EPSRC grant EP/W002779/1


Malcolm.Cook@lboro.ac.uk

The Environmental Study, of the Events Research Programme, led by Dr Liora Malki-Epshtein, was funded by the Department for Digital, Culture, Media & Sport

l.malki-epshtein@ucl.ac.uk




Events Research Programme

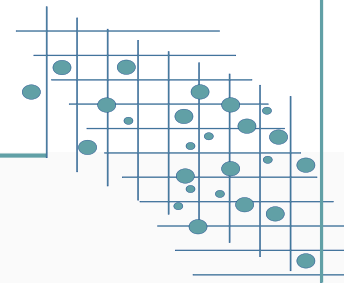

The Process

The research programme was updated every week between April and August 2021

1. The research team attended live events to supervise monitoring and understand how the events were run
2. Phase I: Data was quickly analysed for lessons learnt
3. First reporting cycle to DCMS by May -> for minister review -> overall picture of AQ and analysis of exposures compared with “a day at the office”
4. Phases II-III of ERP planned and executed in rapid succession between April and May 2020
5. Weekly presentations and reports to Science Board
6. Phase III: Risks and mitigations communicated to Science Board and venues – June-July 2020

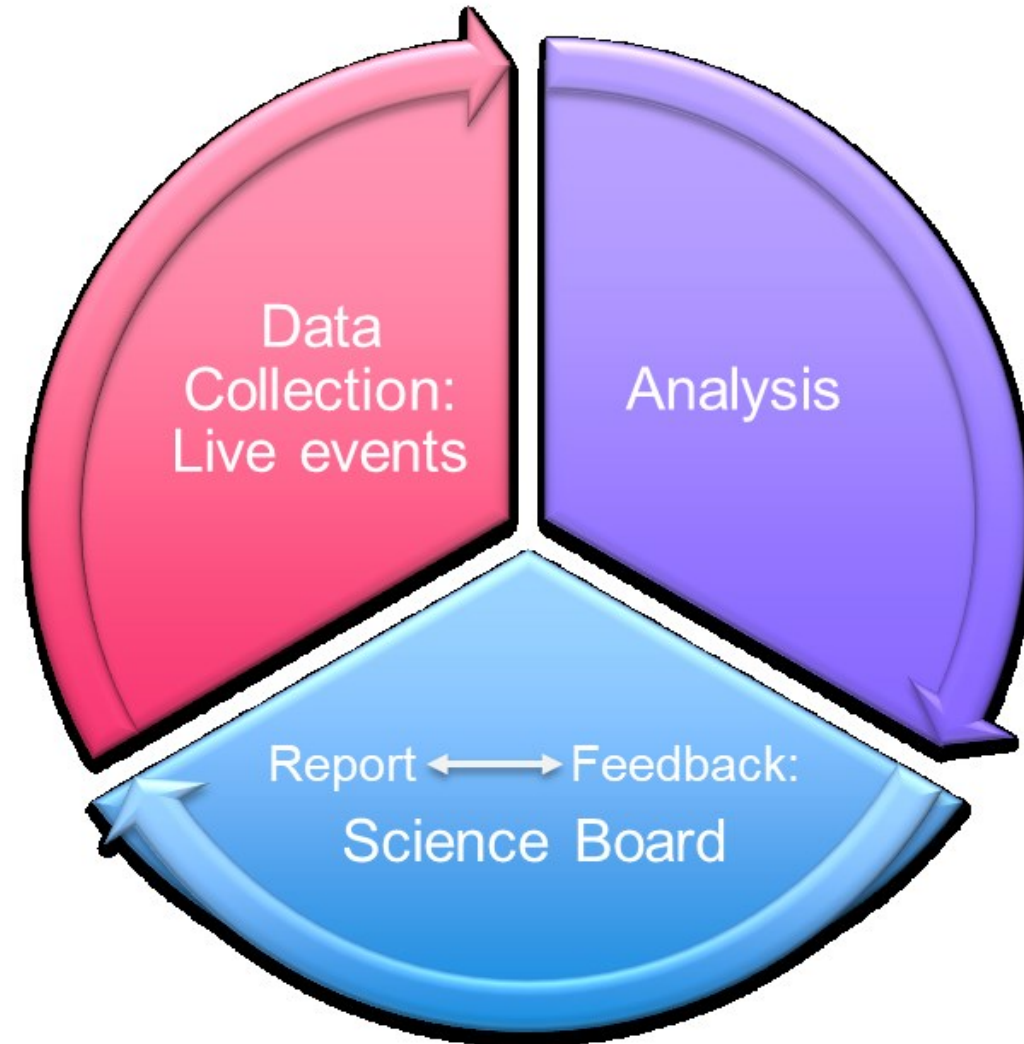

Analysis: Space Classification

Ventilation Classification

- Outdoors
- Outdoors, sheltered
- Indoors, naturally ventilated, high ventilation
- Indoors, naturally ventilated, low ventilation
- Indoors, mechanically ventilated



Usage Classification

- Arrival and Departure Areas
- Dwelling Areas
- Concessions / Bars-Standing
- Bars / Restaurant-Seated
- Main Activity Areas (Structured)
- Main Activity Areas (Unstructured)
- Private Boxes / Meeting Rooms
- Toilets, Corridors, Lifts, Stairwells (small, enclosed, short occupancy)

Analysis: Air Quality Classification

- For the ERP, we proposed a nuanced classification for IAQ based on seven bands of CO₂ concentrations
- All spaces were classified according to their air quality at every event using bands of A to G to enable a detailed assessment of large venues
- Air quality bands were calculated during events for the duration of an event
- We presented finally only bands of average and maximum CO₂ values

Air Quality Bands	Classification	Range of CO ₂ concentrations - Absolute Values (ppm)	Range of excess CO ₂ concentrations - Above outdoor (ppm)
At or marginally above outdoor levels	A	400 - 600	0 - 200
Target for enhanced aerosol generation (singing, aerobic activity)	B	600 - 800	200 - 400
High air quality design standards for offices	C	800 - 1000	400 - 600
Medium air quality	D	1000 - 1200	600 - 800
Design standards for most schools pre-Covid	E	1200 - 1500	800 - 1100
Priority for improvement (SAGE EMG)	F	1500 - 2000	1100 - 1600
Low ventilation/dense occupancy. Must be improved	G	>2000	>1600

Field Studies

Field studies make for challenging projects due to:

- Local risk assessments,
- Bringing equipment on site
- Disturbance to the usual activities occurring on site
- Monitoring and data sharing from existing buildings partners can be at odds with commercial and reputational interests

A Dedicated Laboratory

- Controlled conditions can be created and maintained
- Validation of realistic and complex models; these models can then be applied to a wider range of situations.
- Results are more generalisable to other settings.
- Stronger and wider collaborations between academia, industry and other research agencies made possible
- Data sharing and dissemination
- Different technical solutions can be tested in the laboratory at a fraction of the cost of implementation on a real site

CAVE is designed to enable people to participate in experiments to allow us to measure the user's response to their indoor environment

With a plan area 206m² and height of 9m, CAVE's large size allows indoor environments to be built at full-scale inside the laboratory space.





Our laboratory HVAC systems enable the creation of completely independent "interior" and "exterior" environments


CAVE - the first laboratory in the world explicitly designed to tackle Air Quality challenges and ventilation at full scale

We can, for example:

- Measure the links between indoor overcrowding and disease in the air
- Test solutions to reduce the risk of poor air quality and disease transmission
- Test low energy ventilation technologies under realistic operations
- Quantify the trade-offs between conflicting targets for energy, sustainability and health
- Learn how to improve people's experience of indoor air in terms of health, comfort, and wellbeing

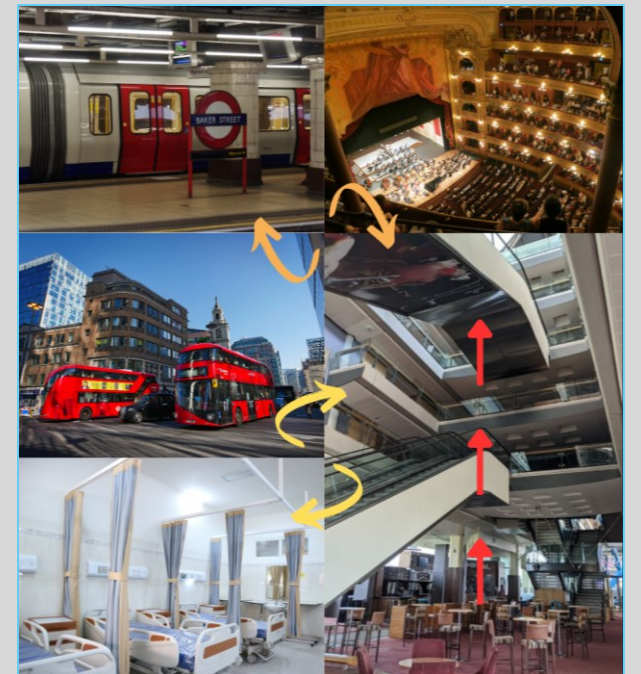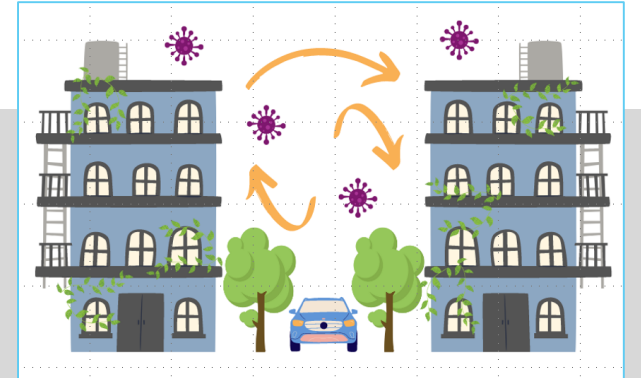

Different scenarios can be built and tested in CAVE

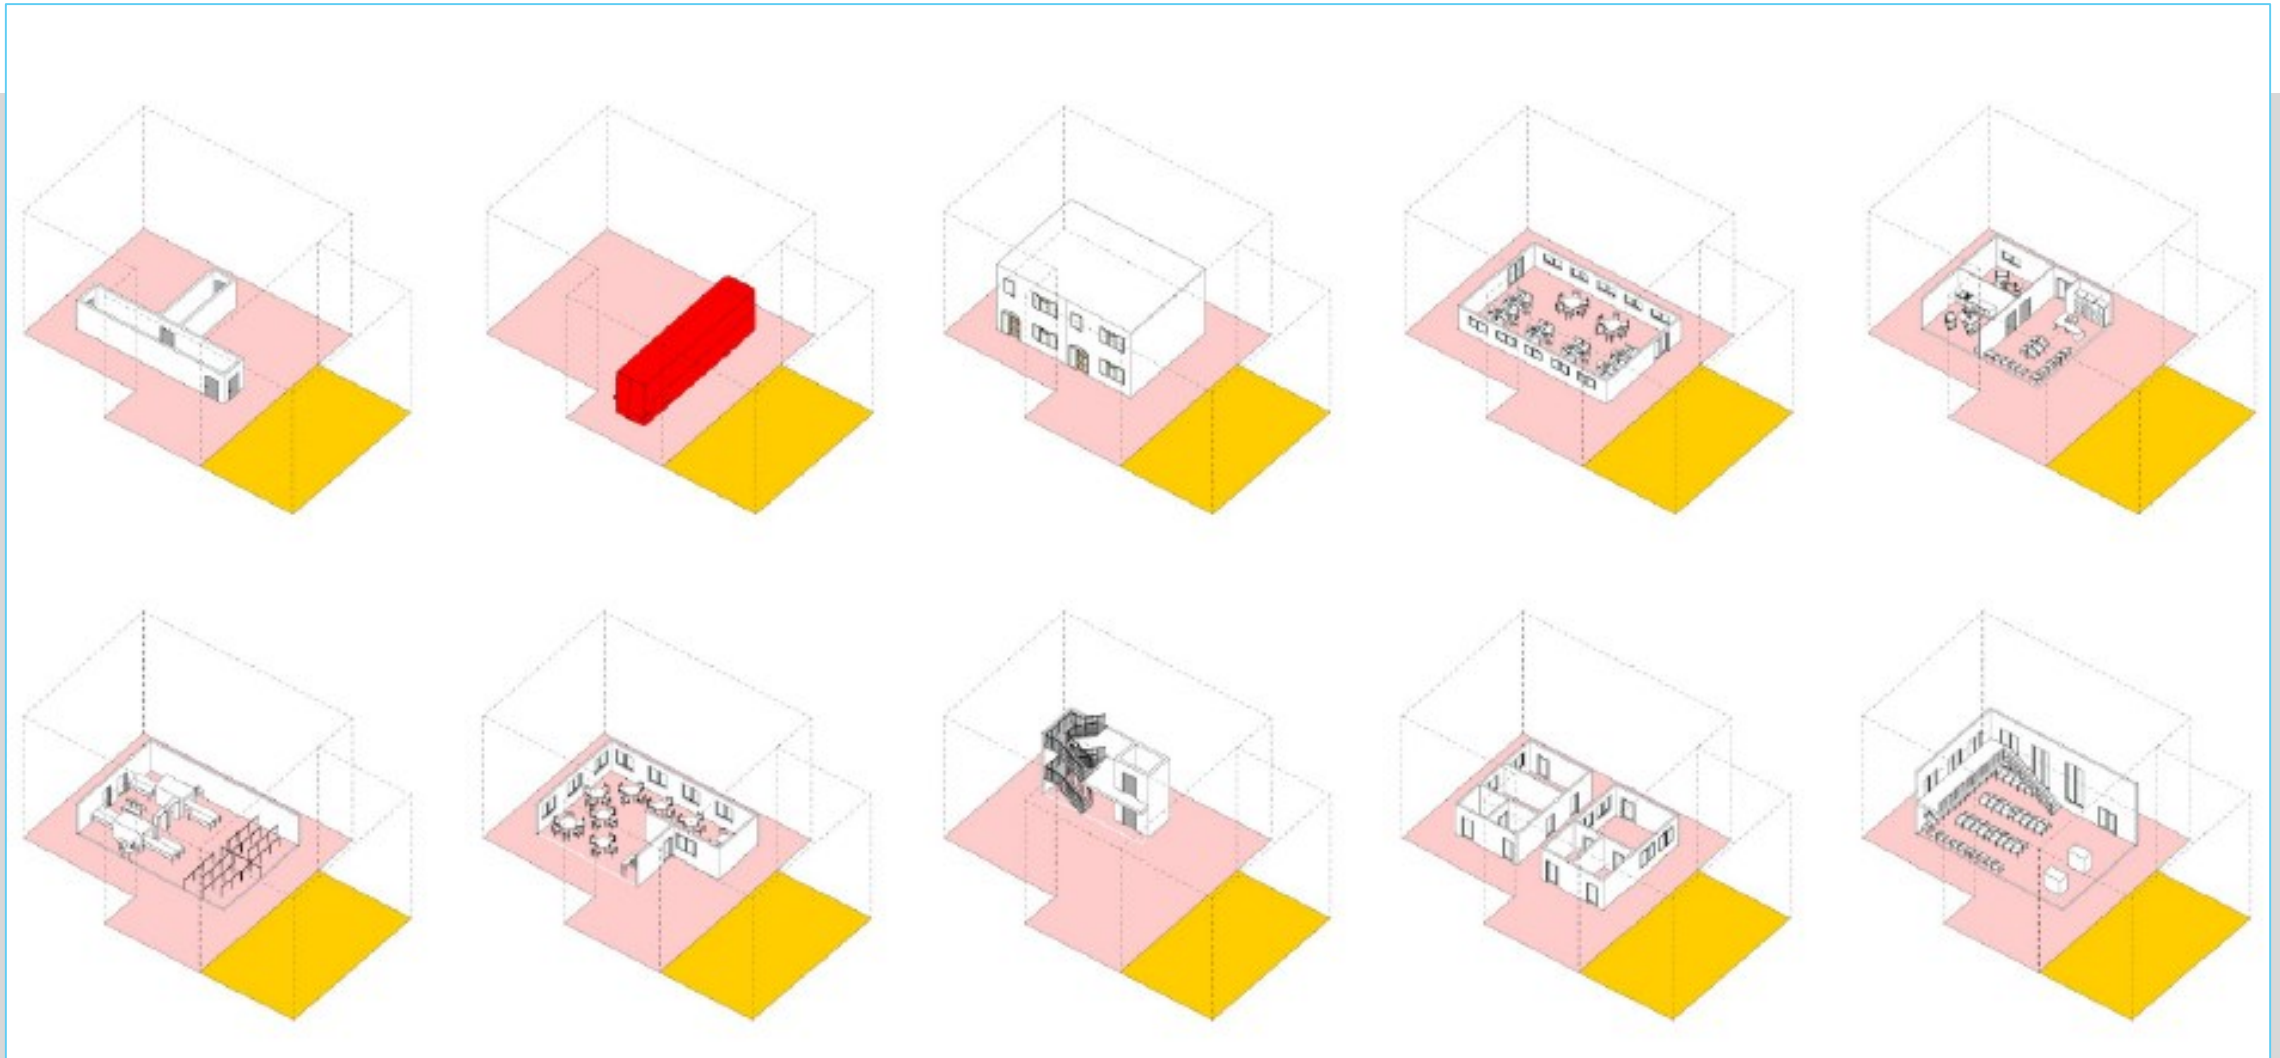

Problem Statement

- Desk study
- Field studies

Modelling


- Energy, heat exchange (IES)
- Airflows, buoyancy effects (CFD)
- Contaminants, dispersion (CONTAM – building scale/ ADMS – street scale / CFD – both)

Design

- Building envelope
- Ventilation systems
- Building components
- Occupant scenarios

Construction

- Building envelope
- Building interiors
- HVAC systems
- Building components

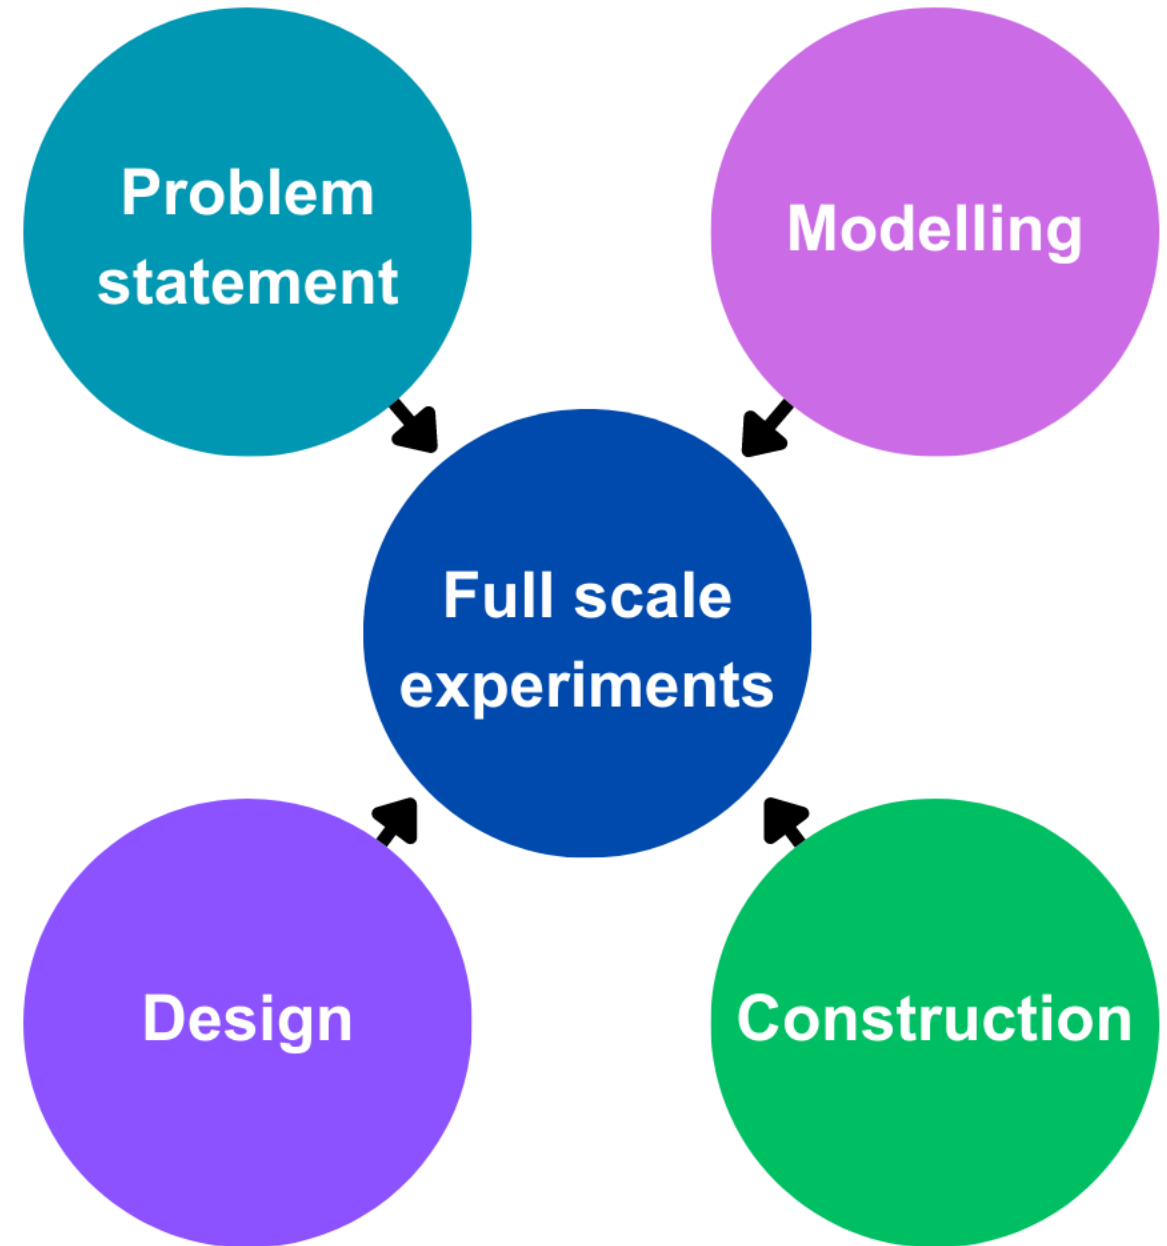

CAVE – Constructed Jan 2022 - April 2023



Contact Details

CAVE is located on the UCL Dagenham East site.

**Yew Tree Avenue
Dagenham RM10 7FN
United Kingdom**

Contact:

Dr Liora Malki-Epshtein, Director,
CAVE l.malki-epshtein@ucl.ac.uk

Dr Fiona Jamieson, Strategic
Partnerships Director, CEGE
fiona.jamieson@ucl.ac.uk

Website:

<https://www.ucl.ac.uk/civil-environmental-geomatic-engineering/controlled-active-ventilation-environment-cave>

Twitter: @cave_lab

